


TESTS ON ANCON STAIFIX AMD MEDIUM DUTY TIMBER FRAME
WALL TIES TO AS/NZ 2699.1:2000

Certificate No. 0192. Test Reference: SW261.02 Issue Date: 14/10/2003

Product

0.61mm thick, 129mm long timber frame wall ties, were tested over a cavity width of 50mm in accordance with AS/NZS 2699.1:200 Built In Components for Masonry Construction, Part 1 Wall Ties. Couplets were made from wire cut clay bricks (comp. strength 45.3N/mm² water absorption 11.4%). Timber end 90mm x 35mm C24 timber using a No.8 dome head wood screw.

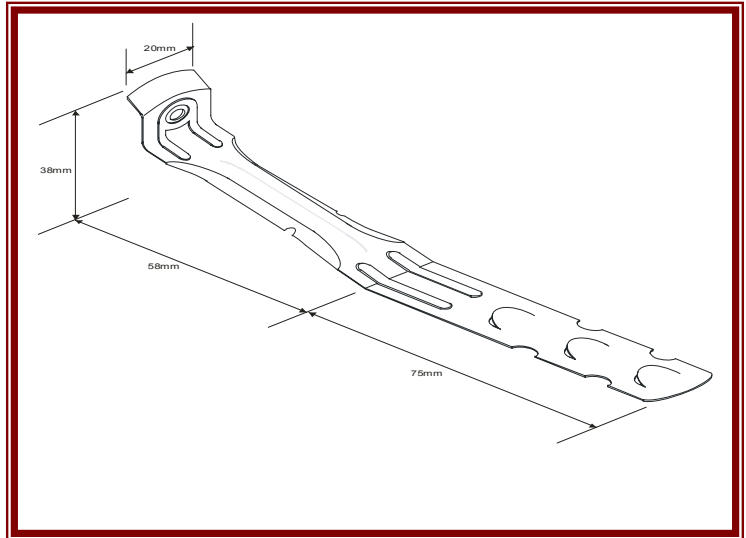

Client

Ancon
BUILDING PRODUCTS
Ancon Building Products
114 Kurrajong Ave
Mount Druitt
Sydney
NSW 2770

Test Results

Summary of Characteristic Values of Ancon Staifix AMD Veneer Ties Tested at 50mm cavity in Designation (iv) mortar and Screwed to Timber Studding with a 10mm Horizontal and 10mm Vertical Applied Displacement

Test	Test Mode	Characteristic Load at 1.5mm Deflection (N)	*AS/NZ 2699.1:200 Recommended Load at 1.5mm Deflection (N)
Tension	Screwed to timber studding using No.8 dome head wood screw	417	400
Compression		488	480
Tension	Built into brick couplet using 1:2:9 mortar	409	400
Compression		501	480

Definition

Type A ties are not required to have specific seismic design characteristics. A Type A masonry veneer tie is defined as a tie, together with its fixings or anchorages, is used to transfer face loads from a veneer to a structural backing while being capable of accommodating differential in-plane horizontal and vertical deflections between the attached elements.

Assessment

The tie having been assessed by CERAM Building Technology against the requirements of AS/NZS 2699.1:2000 meets the requirements of a Type A medium duty masonry veneer tie. Full test results are reported in CERAM Building Technology UKAS Test Report No. SW261.02 issued

Authorised by:

Joanne Booth (Structures Manager)

This report is issued in accordance with the conditions of Business of CERAM Research and relates only to the sample(s) tested. No responsibility is taken for the accuracy of the sampling unless this is done under our own supervision. This report shall not be reproduced in part without the written approval of CERAM Research, nor used in any way as to lead to misrepresentation of the results or their implications.